

# Comparative Study of Wind Load effects for Transmission Towers Using IS 802 And AS/NZS 7000

Harsh Majmundar<sup>1</sup>, Prof. Vishudha Dattani<sup>2</sup>, Dr. Nanak Pamnani<sup>3</sup>

<sup>1</sup>M.Tech Student, Department of civil engineering , S.P.C.E.T. Anand, Gujarat, India

<sup>2</sup>Professor, Department of civil engineering, S.P.C.E.T. Anand , Gujarat, India

<sup>3</sup>Principal, S.P.C.E.T. Anand , Gujarat, India

\*\*\*

**Abstract** - Wind load governs the design of overhead transmission towers due to their height, slender members, and continuous exposure to atmospheric actions. Different design standards adopt different representations of wind characteristics and gust effects, resulting in variation in estimated wind forces and structural response. IS 802 (Part 1/Sec 1):2015 evaluates wind load by converting a 3-second gust wind speed into an equivalent mean wind speed and applying gust response factors. In contrast, AS/NZS 7000:2016 directly uses the 3-second gust wind speed with terrain, shielding, and span-related modification factors and allows separate consideration of synoptic and downdraft wind mechanisms.

In the present study, wind forces on transmission tower components are evaluated using IS 802 (Part 1/Sec 1):2015 and AS/NZS 7000:2016 under identical site conditions. A 132 kV and a 220 kV suspension-type lattice tower are modeled and analyzed using STAAD Pro. Wind forces on conductors, earth wires, and tower body, along with resulting member forces, are compared. The results show that IS 802 generally produces higher forces under synoptic wind conditions, while the difference reduces significantly when downdraft wind provisions of AS/NZS 7000 are considered. This indicates that the higher forces in IS 802 mainly arise from its gust factor-based approach.

**Keywords:** Transmission tower, Wind load, IS 802, AS/NZS 7000, Synoptic wind, Downdraft wind

## 1. INTRODUCTION

Transmission towers are critical structures for power transmission and are highly sensitive to wind loading due to their tall height, open lattice configuration, and long conductor spans. Wind load estimation plays a major role in the design of tower members, foundations, and even moderate variation in wind forces can significantly affect structural safety and economy.

In India, transmission towers are designed in accordance with IS 802 (Part 1/Sec 1):2015, which evaluates wind effects using a mean wind speed combined with gust response factors. International standards such as AS/NZS 7000:2016 adopt a different approach by directly using the 3-second gust wind speed along with terrain, shielding, and span modification factors. AS/NZS 7000 also permits

separate consideration of synoptic and downdraft wind mechanisms, which is not explicitly addressed in IS 802.

Understanding the differences between these approaches is important for evaluating the relative conservatism of wind load provisions and their influence on transmission tower design. The present study compares wind forces and structural response obtained from IS 802 and AS/NZS 7000 through analytical modelling and numerical analysis of typical transmission towers.

## 2. WIND LOAD PROVISIONS IN DESIGN STANDARDS

Wind load on transmission towers depends on wind speed definition, terrain exposure, height variation, gust effects, and spatial correlation along conductor spans. IS 802 (Part 1/Sec 1):2015 and AS/NZS 7000:2016 adopt different formulations for these parameters, leading to variations in calculated wind forces.

### 2.1 Wind Load Provisions as per IS 802 (Part 1/Sec 1):2015

IS 802 defines the basic wind speed as a 3-second gust at 10 m above ground level. For design, this gust wind speed is converted to an equivalent mean wind speed using terrain and height factors. Gust effects on conductors, insulators, and tower members are incorporated through gust response factors.

### 2.2 Wind Load Provisions as per AS/NZS 7000:2016

AS/NZS 7000 uses the 3-second gust wind speed directly for design, modified by direction, terrain, shielding, and topographic multipliers. Gust effects are inherently included, and no separate gust response factor is applied. For conductors, span reduction factors account for spatial correlation, while tower body forces are evaluated using force coefficients based on member shape and solidity ratio.

### 2.3 Synoptic and Downdraft Wind Models in AS/NZS 7000

AS/NZS 7000 allows different wind models based on the governing wind mechanism. Synoptic winds represent large-scale wind systems with relatively uniform wind fields, where span reduction factors significantly reduce conductor forces. Downdraft winds are short-duration, localized, high-intensity winds associated with convective storms, resulting in higher local wind pressures and reduced effectiveness of span reduction factors.

### 2.4 Relevance to Transmission Towers in Indian Conditions

In many parts of India, severe winds affecting transmission lines are commonly associated with thunderstorms and convective activity, which exhibit downdraft-type behavior. IS 802 indirectly accounts for such effects through gust response factors, leading to higher wind force estimates.


The results of the present study indicate that when downdraft wind provisions of AS/NZS 7000 are applied, the difference between IS 802 and AS/NZS 7000 reduces compared to synoptic wind conditions, particularly for conductors at lower heights. However, IS 802 continues to predict higher wind forces on conductors and tower body across most height and span ranges. This indicates that the higher forces obtained from IS 802 primarily arise from its gust factor-based formulation, which introduces increasing conservatism with height, rather than from differences in basic wind speed definition.

## 3. Methodology


Based on the above understanding of wind load modelling approaches, numerical wind force calculations and structural analyses are performed for representative 132 kV and 220 kV suspension type transmission towers. Wind loads are evaluated using IS 802 (Part 1/Sec 1):2015 and AS/NZS 7000:2016 under identical site and terrain conditions, considering both synoptic and downdraft wind models. The resulting forces on conductors, insulators, tower body, and overall structural responses are compared to quantify the influence of each standard.

### 3.1. Tower geometry

- a) Tower geometry for 132kV Tower
  - No. of circuit: Double circuit
  - Angle of deviation: 0-to-2-degree deviation
  - Tower type: Suspension tower
  - Span length: 260m
  - Total height: 26.677m
  - Height of top conductor: 22.71m
  - Height of Middle conductor: 18.714m
  - Height of bottom conductor: 14.666m
  - Base width of tower: 4.250m
  - Conductor: ACSR Panther
  - Optical ground wire = 48 fibers

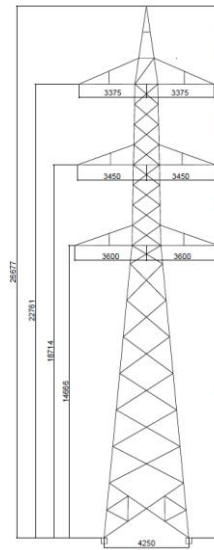

- b) Tower geometry for 220kV Tower
  - No. of circuit: Double circuit
  - Angle of deviation: 0-to-2-degree deviation
  - Tower type: Suspension tower
  - Span length: 350m
  - Total height: 32.165m
  - Height of top conductor: 27.280m
  - Height of Middle conductor: 22.130m
  - Height of bottom conductor: 16.955m
  - Base width of tower: 6.4m
  - Conductor: ACSR Zebra
  - Optical ground wire = 48 fibers

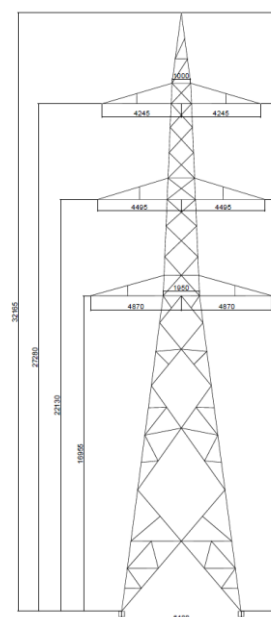

### 3.2. Wind speed Parameters

The following parameters are used for both standards:

Basic wind speed (3-second gust): 47 m/s

Terrain category: Open terrain

Air density: 1.225 kg/m<sup>3</sup>

### 3.3. Tower forces evaluation as per IS 802 (Part 1/Sec 1):2015

#### 1) Forces evaluation for 132kV Tower

##### a) Wind force on conductor (Fwc)

$$F_{wc} = P_d \times A \times C_d \times G_t$$

Where,

$$P_d = \text{Design wind pressure} = 0.6 V_d^2$$

$$V_d = \text{Design wind speed} = V_R \times K_1 \times K_2$$

$$V_R = \text{Reference wind speed} = V_b / K_0$$

K<sub>1</sub> = Risk coefficient

K<sub>2</sub> = Terrain roughness coefficient

K<sub>0</sub> = 1.375

L = Wind span, in m

d = diameter of conductor, in m

C<sub>dc</sub> = Drag coefficient, 1.0 for conductor

1.2 for Earth wire/OPGW

G<sub>c</sub> = Gust response factor, as per Table 7.

For Wind speed 47 m/s

Design wind pressure,

$$P_d = 0.6 \times (47/1.375)^2 \times 1 \times 1, (K_1 \& K_2 = 1)$$

$$P_d = 701.04 \text{ N/m}^2$$

Force on conductor

$$F_{wc} = 701.04 \times 260 \times 0.021 \times 1 \times 2.09 = 8000 \text{ N}$$

##### b) Wind force on OPGW (Fwc)

$$F_{wc} = P_d \times A \times C_d \times G_t$$

$$F_{wc} = 701.04 \times 260 \times 0.0121 \times 1.2 \times 2.09 = 5531.31 \text{ N}$$

##### c) Wind force on Insulator (Fwi)

$$F_{wi} = P_d \times A \times G \times C_{dt}$$

$$= 701.04 \times 2.0 \times 0.3 \times 2.2 \times 1.2 = 1110.44 \text{ N}$$

##### d) Wind force on tower body (Fwt)

$$F_{wt} = P_d \times A \times C_d \times G_T$$

A = net area of tower

C<sub>d</sub> = Drag coefficient of tower based on solidity ratio, as per table 5,

$$\text{Solidity ratio} = \text{Net area} / \text{Total area} = 13.98 / 63.96 = 0.22$$

C<sub>d</sub> = 3.42

$$F_{wt} = 701.04 \times 13.98 \times 3.42 \times 2.2 = 73739 \text{ N}$$

Nos. of nodes = 57

$$\text{Load on each node} = 73739 / 57 = 1293.67 \text{ N}$$

##### e) Self-weight of conductor

$$V_c = \text{Span length} \times \text{unit weight} = 260 \times 9.55 = 2483 \text{ N}$$


##### f) Self-weight of OPGW

$$V_c = \text{Span length} \times \text{unit weight} = 260 \times 3.79 = 985 \text{ N}$$

##### g) Self-weight of insulator and man-tools load

$$V_i = 300 \text{ kg} = 3000 \text{ N}$$

##### h) Staad model for 132kV Tower :

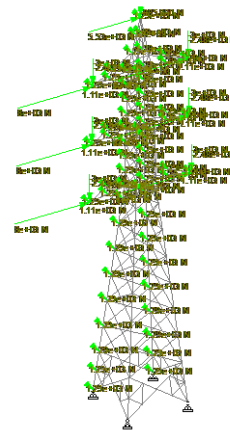

#### 2) Forces evaluation for 220kV Tower

##### a) Wind force on conductor (Fwc)

$$F_{wc} = P_d \times A \times C_d \times G_t$$

P<sub>d</sub>, same as above calculation

$$P_d = 701.04 \text{ N/m}^2$$

Force on conductor

$$F_{wc} = 701.04 \times 350 \times 0.02862 \times 1 \times 2.16 = 15168.2 \text{ N}$$

##### b) Wind force on OPGW (Fwc)

$$F_{wc} = P_d \times A \times C_d \times G_t$$

$$F_{wc} = 701.04 \times 350 \times 0.0121 \times 1.2 \times 2.16 = 7695.38 \text{ N}$$

##### c) Wind force on Insulator (Fwi)

$$F_{wi} = P_d \times A \times G \times C_{dt}$$

$$= 701.04 \times 3.0 \times 0.3 \times 2.3 \times 1.2 = 1741.38 \text{ N}$$

##### d) Wind force on tower body (Fwt)

$$F_{wt} = P_d \times A \times C_d \times G_T$$

A = net area of tower

C<sub>d</sub> = Drag coefficient of tower based on solidity ratio, as per table 5,

$$\text{Solidity ratio} = \text{Net area} / \text{Total area} = 17.95 / 110.96 = 0.162$$

C<sub>d</sub> = 3.50

$$F_{wt} = 701.04 \times 17.95 \times 3.50 \times 2.3 = 101298 \text{ N}$$

Nos. of nodes = 37  
 Load on each node = 101298/37  
 = 2737.79 N

**e) Self-weight of conductor**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 350 \times 15.90 = 5565.71 \text{ N}$


**f) Self-weight of OPGW**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 350 \times 3.79 = 1326.5 \text{ N}$

**g) Self-weight of insulator and man-tools load**

$V_i = 300\text{kg} = 3000\text{N}$

**h) Staad model for 220kV Tower :**

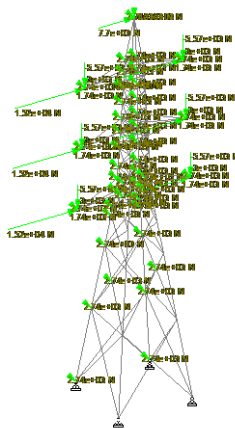

$\alpha = \text{Angle of wind direction,} = 0$

$C_d = \text{Drag coefficient, 1.0 for conductor}$   
 $\text{SRF} = \text{Span reduction factor}$

For Wind speed 47 m/s

$V_R = 47\text{m/s}$

$M_d = 1.0$

$M_{z,\text{cat}} = 1.09$

$M_s = 1.0$

$M_t = 1.0$

Design wind pressure,

$q_z = 0.6 \times (47 \times 1.09)^2$

$P_d = 1574.71 \text{ N/m}^2$

Force on conductor

$F_c = 1574.71 \times 1.0 \times 260 \times 0.021 \times 0.725$   
 $= 6233.48 \text{ N}$

**b) Wind force on OPGW (Fc)**

$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \text{COS}^2\alpha$   
 $= 1574.71 \times 1.2 \times 260 \times 0.0121 \times 0.725$   
 $= 4310.01 \text{ N}$

**c) Wind force on Insulator (Fi)**

$F_i = q_z \times C_d \times A$   
 $= 1574.71 \times 1.2 \times 2.0 \times 0.3$   
 $= 1133.79 \text{ N}$

**d) Wind force on tower body (Fs)**

$F_s = q_z \times C_d \times A \times \text{COS}^2\alpha$   
 $A = \text{member area} = 13.98 \text{ m}^2$   
 $C_d = 3.06$   
 $F_s = 1574.71 \times 3.06 \times 13.98$   
 $= 67364.10 \text{ N}$

Nos. of nodes = 57

Load on each node = 67364.10/57  
 $= 1181.83 \text{ N}$

**e) Self-weight of conductor**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 260 \times 9.55 = 2483 \text{ N}$

**f) Self-weight of OPGW**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 260 \times 3.79 = 985 \text{ N}$

**g) Self-weight of insulator and man-tools load**

$V_i = 300\text{kg} = 3000\text{N}$

**h) Staad model for 132kV Tower :**

**3.4. Tower forces evaluation as per AS/NZS 7000:2016, Considering synoptic wind condition**

**1) Forces evaluation for 132kV Tower**

**a) Wind force on conductor (Fc)**

$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \text{COS}^2\alpha$

Where,

$q_z = \text{Design wind pressure} = 0.6 \times V_{\text{sit},\beta}^2$

$V_{\text{sit},\beta} = \text{Design site wind speed}$

$= V_R \times M_d \times M_{z,\text{cat}} \times M_s \times M_t$

$V_R = \text{Basic regional wind velocity}$

$M_d = \text{Wind direction multiplier}$


$M_{z,\text{cat}} = \text{Gust wind speed multiplier for terrain category at height Z}$

$M_s = \text{Shielding multiplier}$

$M_t = \text{Topographic multiplier}$

$L = \text{Wind span, in m}$

$d = \text{diameter of conductor, in m}$

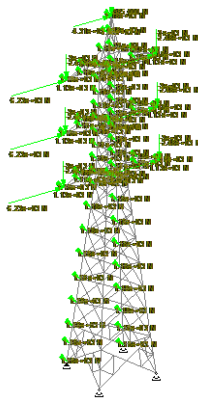

f) Self-weight of OPGW


$$V_c = \text{Span length} \times \text{unit weight}$$

$$= 350 \times 3.79 = 1326.5 \text{ N}$$

g) Self-weight of insulator and man-tools load

$$V_i = 300\text{kg} = 3000\text{N}$$

h) Staad model for 220kV Tower :

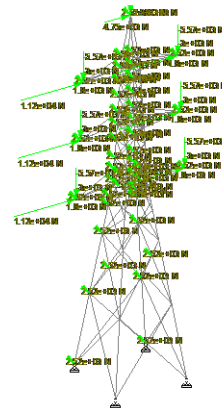

2) Forces evaluation for 220kV Tower

a) Wind force on conductor (Fc)

$$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \cos^2\alpha$$

Where,

$$V_R = 47\text{m/s}$$

$$M_d = 1.0$$

$$M_{z,\text{cat}} = 1.12$$

$$M_s = 1.0$$

$$M_t = 1.0$$

Design wind pressure,

$$q_z = 0.6 \times (47 \times 1.12)^2$$

$$P_d = 1662.58 \text{ N/m}^2$$

Force on conductor

$$F_c = 1662.58 \times 1.0 \times 350 \times 0.02862 \times 0.675$$

$$= 11241.58\text{N}$$

b) Wind force on OPGW (Fc)

$$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \cos^2\alpha$$

$$= 1662.58 \times 1.0 \times 350 \times 0.0121 \times 0.675$$

$$= 4752.70 \text{ N}$$

c) Wind force on Insulator (Fi)

$$F_i = q_z \times C_d \times A$$

$$= 1662.58 \times 1.2 \times 3.0 \times 0.3$$

$$= 1795.59 \text{ N}$$

d) Wind force on tower body (Fs)

$$F_s = q_z \times C_d \times A \times \cos^2\alpha$$

$$A = \text{member area} = 17.95 \text{ m}^2$$

$$C_d = 3.13$$

$$F_s = 1662.58 \times 3.13 \times 17.95$$

$$= 93409.7 \text{ N}$$

Nos. of nodes = 37

Load on each node =  $93409.7/37$

$$= 2524.59 \text{ N}$$

e) Self-weight of conductor

$$V_c = \text{Span length} \times \text{unit weight}$$

$$= 350 \times 15.90 = 5565.71 \text{ N}$$

3.4. Tower forces evaluation as per AS/NZS 7000:2016, Considering downdraft wind

3) Forces evaluation for 132kV Tower

a) Wind force on conductor (Fc)

$$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \cos^2\alpha$$

$$V_R = 47\text{m/s}$$

$$M_d = 1.0$$

$$M_{z,\text{cat}} = 1.0$$

$$M_s = 1.0$$

$$M_t = 1.0$$

$$\text{SRF} = 1.0$$

Design wind pressure,

$$q_z = 0.6 \times (47 \times 1.00)^2$$

$$P_d = 1325.40 \text{ N/m}^2$$

Force on conductor

$$F_c = 1325.40 \times 1.0 \times 260 \times 0.021 \times 0.98$$

$$= 7091.95 \text{ N}$$

b) Wind force on OPGW (Fc)

$$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \cos^2\alpha$$

$$= 1325.40 \times 1.2 \times 260 \times 0.0121 \times 0.98$$

$$= 4903.58 \text{ N}$$

c) Wind force on Insulator (Fi)

$$F_i = q_z \times C_d \times A$$

$$= 1325.40 \times 1.2 \times 2.0 \times 0.3$$

$$= 954.288 \text{ N}$$

d) Wind force on tower body (Fs)

$$F_s = q_z \times C_d \times A \times \cos^2\alpha$$

$$A = \text{member area} = 13.98 \text{ m}^2$$

$$C_d = 3.06$$

$$F_s = 1325.40 \times 3.06 \times 13.98$$

= 56699 N

Nos. of nodes = 57

Load on each node = 56699/57

= 994.72 N

**e) Self-weight of conductor**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 260 \times 9.55 = 2483 \text{ N}$


**f) Self-weight of OPGW**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 260 \times 3.79 = 985 \text{ N}$

**g) Self-weight of insulator and man-tools load**

$V_i = 300\text{kg} = 3000\text{N}$

**h) Staad model for 132kV Tower :**

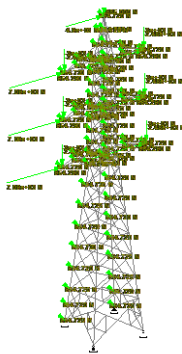

**4) Forces evaluation for 220kV Tower**

**a) Wind force on conductor (Fc)**

$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \text{COS}^2\alpha$   
 $F_c = 1325.40 \times 1.0 \times 350 \times 0.02862 \times 0.953$   
 $= 12652.53\text{N}$

**b) Wind force on OPGW (Fc)**

$F_c = q_z \times C_d \times L \times d \times \text{SRF} \times \text{COS}^2\alpha$   
 $= 1325.4 \times 1.0 \times 350 \times 0.0121 \times 0.953$   
 $= 5349.25 \text{ N}$

**c) Wind force on Insulator (Fi)**

$F_i = q_z \times C_d \times A$   
 $= 1325.40 \times 1.2 \times 3.0 \times 0.3$   
 $= 715.72\text{N}$

**d) Wind force on tower body (Fs)**

$F_s = q_z \times C_d \times A \times \text{COS}^2\alpha$   
 $A = \text{member area} = 17.95 \text{ m}^2$   
 $C_d = 3.13$   
 $F_s = 1325.40 \times 3.13 \times 17.95$   
 $= 74465.6 \text{ N}$

**e) Self-weight of conductor**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 350 \times 15.90 = 5565.71 \text{ N}$

**f) Self-weight of OPGW**

$V_c = \text{Span length} \times \text{unit weight}$   
 $= 350 \times 3.79 = 1326.5 \text{ N}$


**g) Self-weight of insulator and man-tools load**

$V_i = 300\text{kg} = 3000\text{N}$

Particular	IS 802 : (PART 1 /SEC 1) :2015	AS/NZS 7000 :2016 (synoptic wind)	% Difference w.r.t I
Wind force on conductor for 132kV Tower	8000.00 N	6233.48 N	22%
Wind force on tower body for 132kV Tower	73739 N	39075.60 N	9%
Max. compressive force for 132kV Tower	295441.74 N	201175.72 N	13%
Max. tensile force for 132kV Tower	265627.32 N	171169.19 N	15%
Max. Shear force for 132kV Tower	1912.10 N	1617.56 N	8%
Wind force on conductor for 220kV Tower	15168.20 N	11241.58 N	26%
Wind force on tower body for 220kV Tower	101298.00 N	54911.80 N	8%
Max. compressive force for 220kV Tower	384312.19 N	322999.63 N	16%
Max. tensile force for 220kV Tower	345422.06 N	283927.43 N	18%
Max. shear force for 220kV Tower	1317.60 N	1152.05 N	13%

Nos. of nodes = 37

Load on each node = 74465.6/37  
 $= 2012.58 \text{ N}$

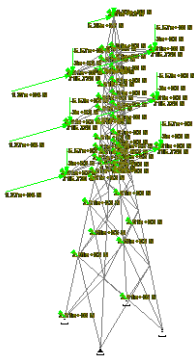

**h) Staad model for 220kV Tower**

**4.0. Result and comparison**

Particular	IS 802 : (PART 1/SEC 1) :2015	AS/NZS 7000 :2016 (downdraft wind)	% Difference w.r.t. IS 802
Wind force on conductor for 132kV Tower	8000.00 N	7091.95 N	11%
Wind force on tower body for 132kV Tower	73739 N	56699.00 N	23%
Max. compressive force for 132kV Tower	295441.74 N	246314.59 N	17%
Max. tensile force for 132kV Tower	265627.32 N	216404.80 N	19%
Max. Shear force for 132kV Tower	1912.10 N	1756.07 N	8%
Wind force on conductor for 220kV Tower	15168.20 N	12652.53 N	17%
Wind force on tower body for 220kV Tower	101298.00 N	74465.60 N	26%
Max. compressive force for 220kV Tower	384312.19 N	297035.43 N	23%
Max. tensile force for 220kV Tower	345422.06 N	257526.37 N	25%
Max. shear force for 220kV Tower	1317.60 N	1072.76 N	19%

**5.0 DISCUSSION**

- a) IS 802 produces higher conductor forces under synoptic wind (22–26%) mainly due to the application of gust response factors after converting gust wind speed to mean wind speed, which increases wind demand on flexible components.
- b) AS/NZS 7000 predicts lower conductor forces under synoptic wind because span reduction factors account for reduced spatial correlation of wind pressure over long spans, significantly moderating conductor loads.
- c) Tower body forces under synoptic wind show limited variation (within about ±10%) between the two standards, indicating similar treatment of force

coefficients and height-dependent wind profiles for lattice structures.

- d) Under downdraft wind conditions, AS/NZS 7000 results in progressively higher wind forces with increasing height, reducing the influence of span reduction and leading to larger differences with IS 802 (up to ~15% for conductors , ~25% for tower body and , ~20% for member forces).
- e) Structural analysis confirms that member axial forces and base reactions directly reflect the applied wind load trends, with IS 802 consistently yielding higher internal forces due to its more conservative gust treatment.

**6.0 CONCLUSIONS**

- a) Wind forces on conductors obtained using IS 802 are consistently higher than those from AS/NZS 7000, with differences of about 22–26% under synoptic wind conditions.
- b) Under downdraft wind conditions, the difference in conductor wind force increases with height, ranging from nearly zero at lower heights to about 20% at higher elevations, indicating strong height dependency.
- c) Wind force acting on the tower body shows relatively small variation between the two standards under synoptic wind, generally within ±10%, and in some cases AS/NZS 7000 produces marginally higher values.
- d) For downdraft wind, tower body forces calculated using IS 802 increases significantly with height, with differences reaching up to 25–30% at higher levels.
- e) Structural analysis results indicate that the overall tower response is governed mainly by conductor wind loads, while tower body wind loads have a secondary influence for multi circuit towers.
- f) The study highlights that explicit consideration of wind mechanisms such as synoptic and downdraft winds, as provided in AS/NZS 7000, can lead to more rational and transparent wind load assessment for transmission towers

**REFERENCES**

- [1] IS 802 (Part 1/Sec 1):2015 Use of Structural Steel in Overhead Transmission Line Towers -Code of Practice. AS/NZS 7000:2016 Overhead line design
- [2] Rahul Dhama, B.S. Tyagi; “Analysis of Transmission Tower of 132 KVA under Different Wind Loads (as per IS:875-2015 Part-III) by using STAAD Pro” International Research Journal of Engineering and Technology, July 2020, Volume 07, Issue 07.
- [3] Ghugal Y.M. and Salunkhe U.S.; Analysis and Design of Three-Legged 400kV Double Circuit Steel Transmission Line Towers”; International journal of Civil Engineering and Technology (IJCIET), Volume 4, Issue-3, May-June (2013), pp197-209.

- [4] Bhardwaj H. L., Ajit, and Kaushik Y; “Analysis and Design of Four Leg Steel Transmission Tower Using STAAD.Pro”, International Journal of Advanced Engineering, Management and Science (IJAEMS), Volume 1, Issue-4, July- 2015, pp 7-13.
- [5] Tanvi G. Londhe, Prof. M.S. Kakamare, “Comparative Study of Dynamic Analysis of Transmission Towers”, International Research Journal of Engineering and Technology (IRJET), Volume 05, Issue 08, Aug 2018.
- [6] Balaji Patil, K.S. Upase, Prof. Hamne A.A.; “Design and analysis of transmission line tower using Staad pro., Volume 07, Issue 07, July 2020.
- [7] Naga Subramanian G.; “Design of cell transmission tower with different bracing patters”, Volume 10, Issue 12, Dec 2023.